




Activity 5 – Pipe Up!

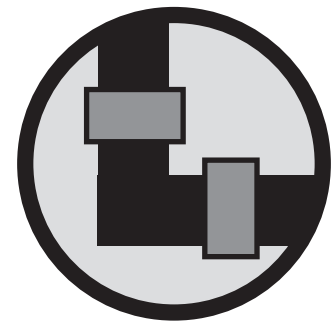


Copper Pipe with Lead Solder: Solder made or installed before 1986 contained high lead levels.

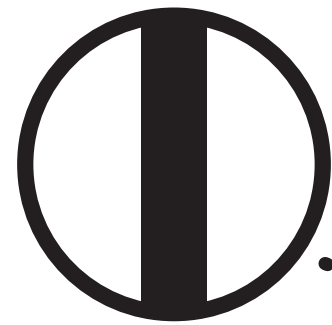


Lead Service Line: The service line is the pipe that runs from the water main to the home's internal plumbing. Lead service lines can be a major source of lead contamination in water.

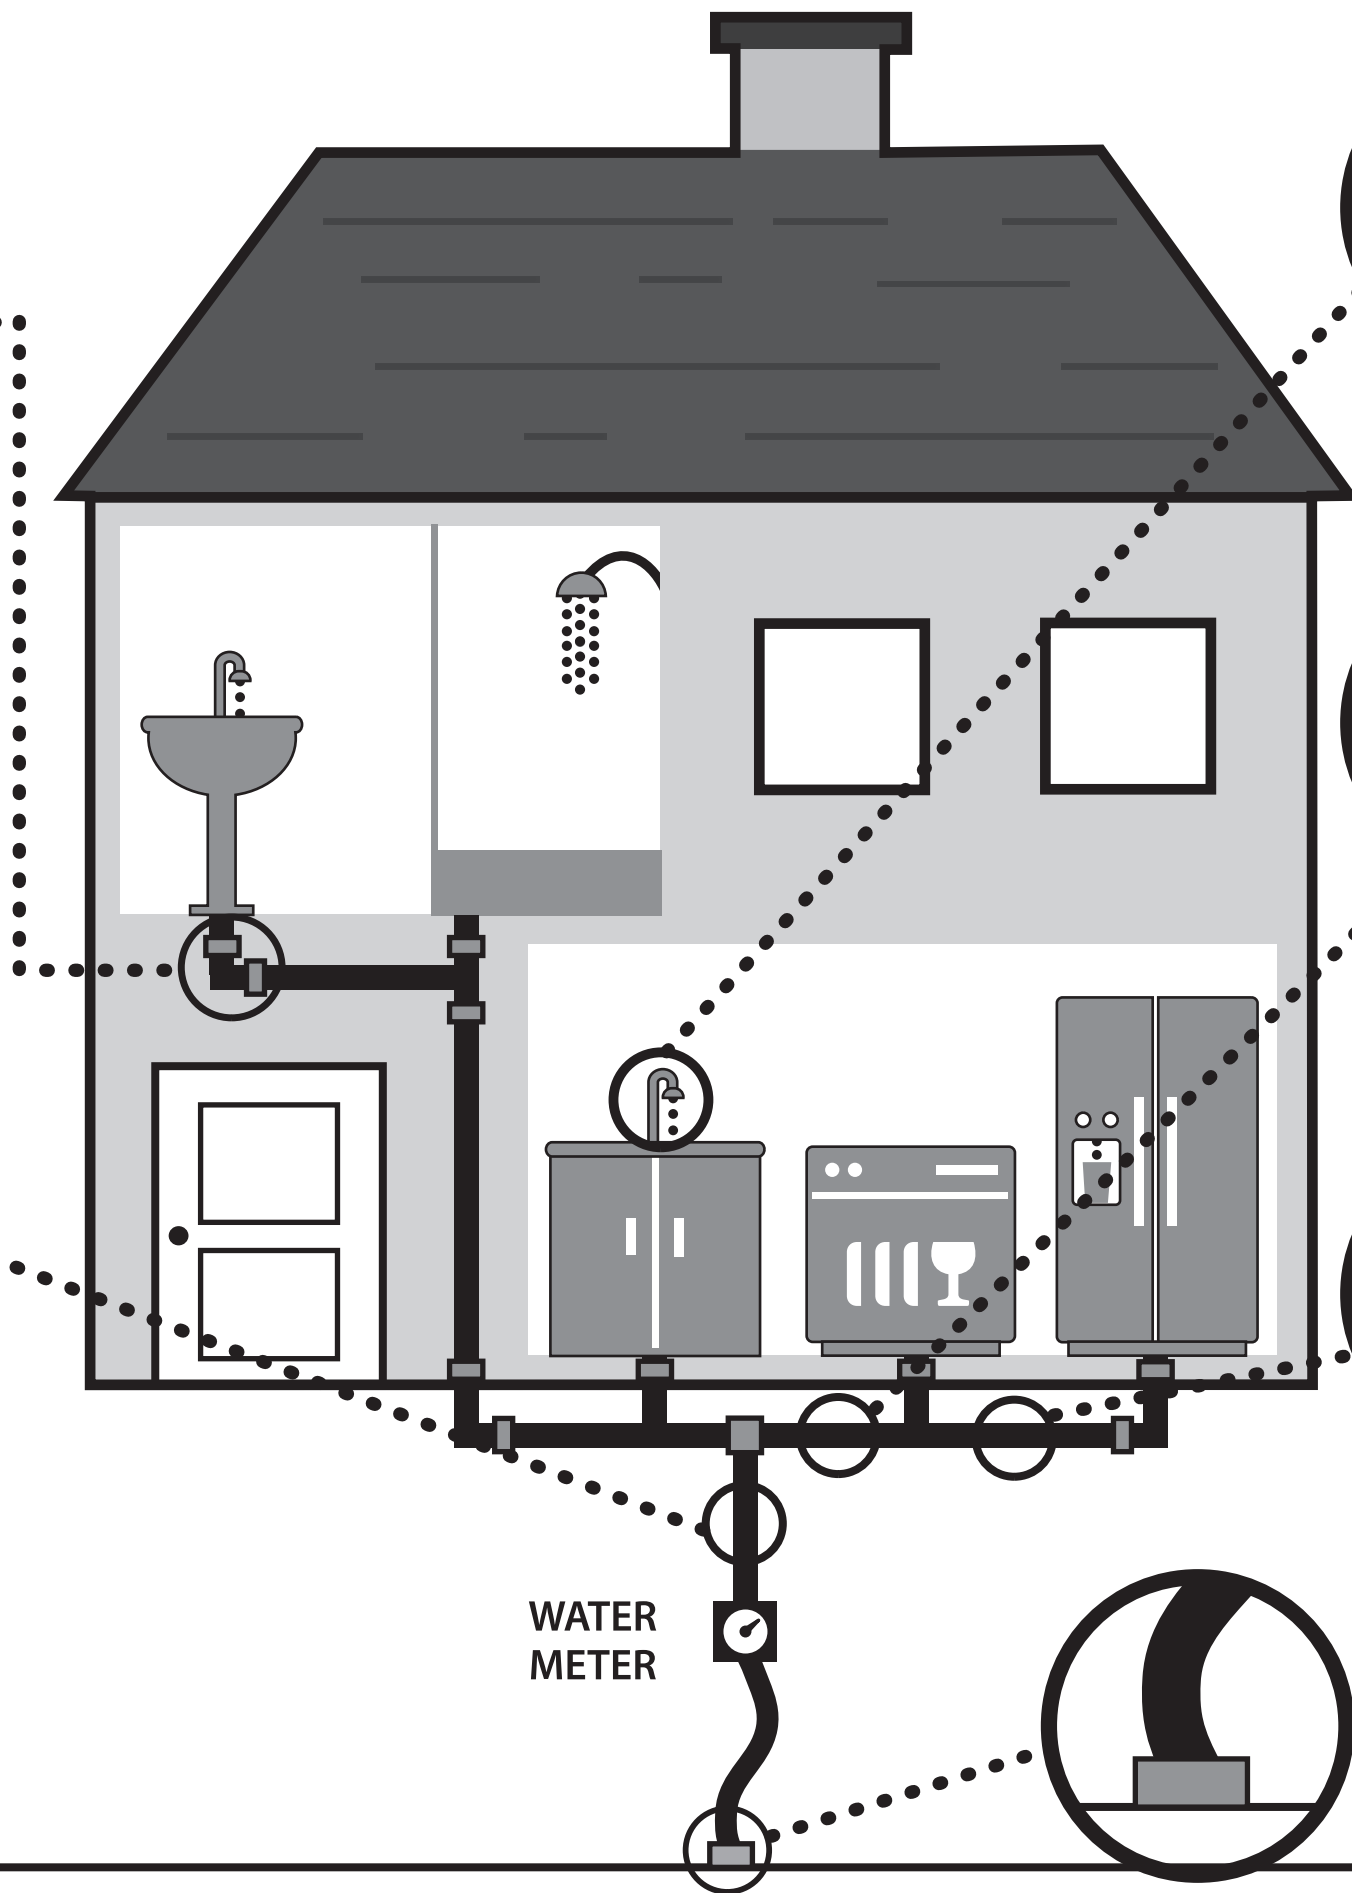


Faucets: Fixtures inside your home may contain lead.

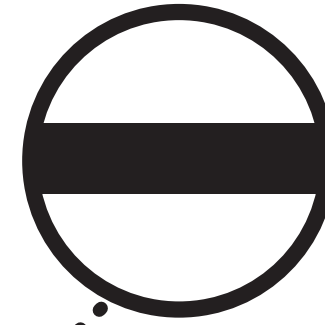

Galvanized Pipe: Lead particles can attach to the surface of galvanized pipes. Over time, the particles can enter your drinking water, causing elevated lead levels.

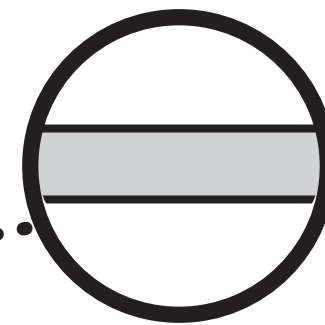

PVC Pipe: 70% of homes in the U.S. have PVC pipes and should be marked to show they meet current drinking water standards.

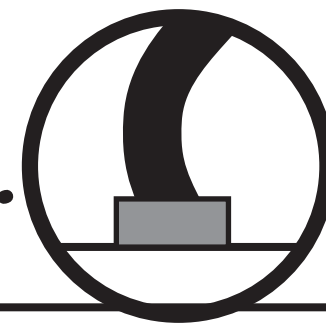

Lead Goose Necks: Goose necks and pigtails are shorter pipes that connect the lead service line to the water main.

WATER METER

MAIN WATER LINE